

CERTIFICATE OF CONFORMITY

Issued to: Wuxi Wattsonic Energy Technology Co., LTD.
Floor 4 Building H1 NO.6 Jingxian Road, Xinwu District, Wuxi 214135, China

For the product: Hybrid Inverter

Trade name: WATTSONIC

Type/Model: CISION-29.9KW-100A, CISION-30KW-100A, CISION-36KW-100A,
CISION-40KW-100A, CISION-50KW-100A

Ratings: See Annex

Manufactured by: Wuxi Wattsonic Energy Technology Co., LTD.
Floor 4 Building H1 NO.6 Jingxian Road, Xinwu District, Wuxi 214135, China

Requirements: TOR Erzeuger Type A Version 1.2:2022-04-11
OVE-Richtlinie R 25:2020-03-01

This Test Certificate is granted on account of an examination by DEKRA, the results of which are laid down in a confidential file no. 6207369.50


The examination has been carried out on one single specimen of the product. The Attestation does not include an assessment of the manufacturer's production. Conformity of this production with the specimen tested by DEKRA is not the responsibility of DEKRA.

This Test Certificate expires at the latest on 29 August 2030 or expires upon withdrawal of one of the above mentioned standards.

Shanghai, 29 August 2025


Certificate Number: 6207369.01COC

DEKRA Testing and Certification (Shanghai) Ltd.



Kreny Lin
Certification Manager

© Integral publication of this certificate and adjoining reports is allowed

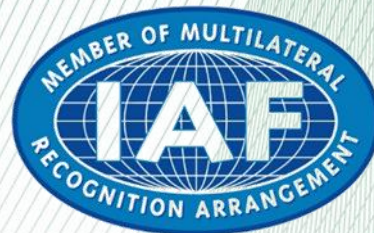

PCA-141

DEKRA Testing and Certification (Shanghai) Ltd.

No.250, Jiangchangsan Road, Jing'an District, Shanghai, 200436 People's Republic of China

T +86 21 6056 7600 F +86 21 6056 7555 www.dekra-product-safety.com

ESA-CER-F021 v4.1

Document no. : 6207369.01COC

Test basics:

TOR Erzeuger Type A Version 1.2:2022-04-11

Connection and parallel operation of Type A power generation systems and small-scale generation systems

OVE-Richtlinie R 25: 2020-03-01

Test requirements for generator units to be connected to and operated in parallel with low-voltage distribution networks

- 5.1 Testing the network perturbations
- 5.2 Testing the symmetry behavior of three-phase inverters
- 5.3 Testing the behavior of the generating unit on the network
- 5.4 Testing the automatic activation point
- 5.5 Testing the connection conditions and synchronization
- 5.6 Proof of robustness and dynamic network support

Ratings of product:

Operating temperature range: - 30°C to + 60°C

Protective class: IP66

Power factor range (adjustable): -0.8(lagging)~0.8(leading)

CISION-29.9KW-100A

PV input: Max. 1000 Vdc, MPPT voltage range: 180-950 Vdc, Max Current: 4*40 A,

BAT: Voltage range: 200-800 Vdc, Max Current: 2*50 A,

Output: 3L/N/PE, 220/380 V, 230/400 V, 240/415 V, 50/60 Hz,

Rated Power: 29.9 kW, Max. Apparent Power: 29.9 kVA,

Rated current: 43.3 A, Max. current: 43.3 A

CISION-30KW-100A

PV input: Max. 1000 Vdc, MPPT voltage range: 180-950 Vdc, Max Current: 4*40 A,

BAT: Voltage range:200-800 Vdc, Max Current: 2*50 A,

Output: 3L/N/PE, 220/380 V, 230/400 V, 240/415 V, 50/60 Hz,

Rated Power: 30 kW, Max. Apparent Power: 33 kVA,

Rated current: 43.4 A, Max. current: 47.8 A

CISION-36KW-100A:

PV input: Max. 1000 Vdc, MPPT voltage range: 180-950 Vdc, Max Current: 4*40 A,

BAT: Voltage range:200-800 Vdc, Max Current: 2*50 A,

Output: 3L/N/PE, 220/380 V, 230/400 V, 240/415 V, 50/60 Hz,

Rated Power: 36 kW, Max. Apparent Power: 39.6 kVA,

Rated current: 52.1 A, Max. current: 57.3 A

CISION-40KW-100A:

PV input: Max. 1000 Vdc, MPPT voltage range: 180-950 Vdc, Max Current: 4*40 A,

BAT: Voltage range:200-800 Vdc, Max Current: 2*50 A,

Output: 3L/N/PE, 220/380 V, 230/400 V, 240/415 V, 50/60 Hz,

Rated Power: 40 kW, Max. Apparent Power: 44 kVA,

Rated current: 57.9 A, Max. current: 63.7 A

CISION-50KW-100A:

PV input: Max. 1000 Vdc, MPPT voltage range: 180-950 Vdc, Max Current: 4*40 A,

BAT: Voltage range:200-800 Vdc, Max Current: 2*50 A,

Output: 3L/N/PE, 220/380 V, 230/400 V, 240/415 V, 50/60 Hz,

Rated Power: 50 kW, Max. Apparent Power: 55 kVA,

Rated current: 72.4 A, Max. current: 79.7 A

--END--